




Smarter Solutions

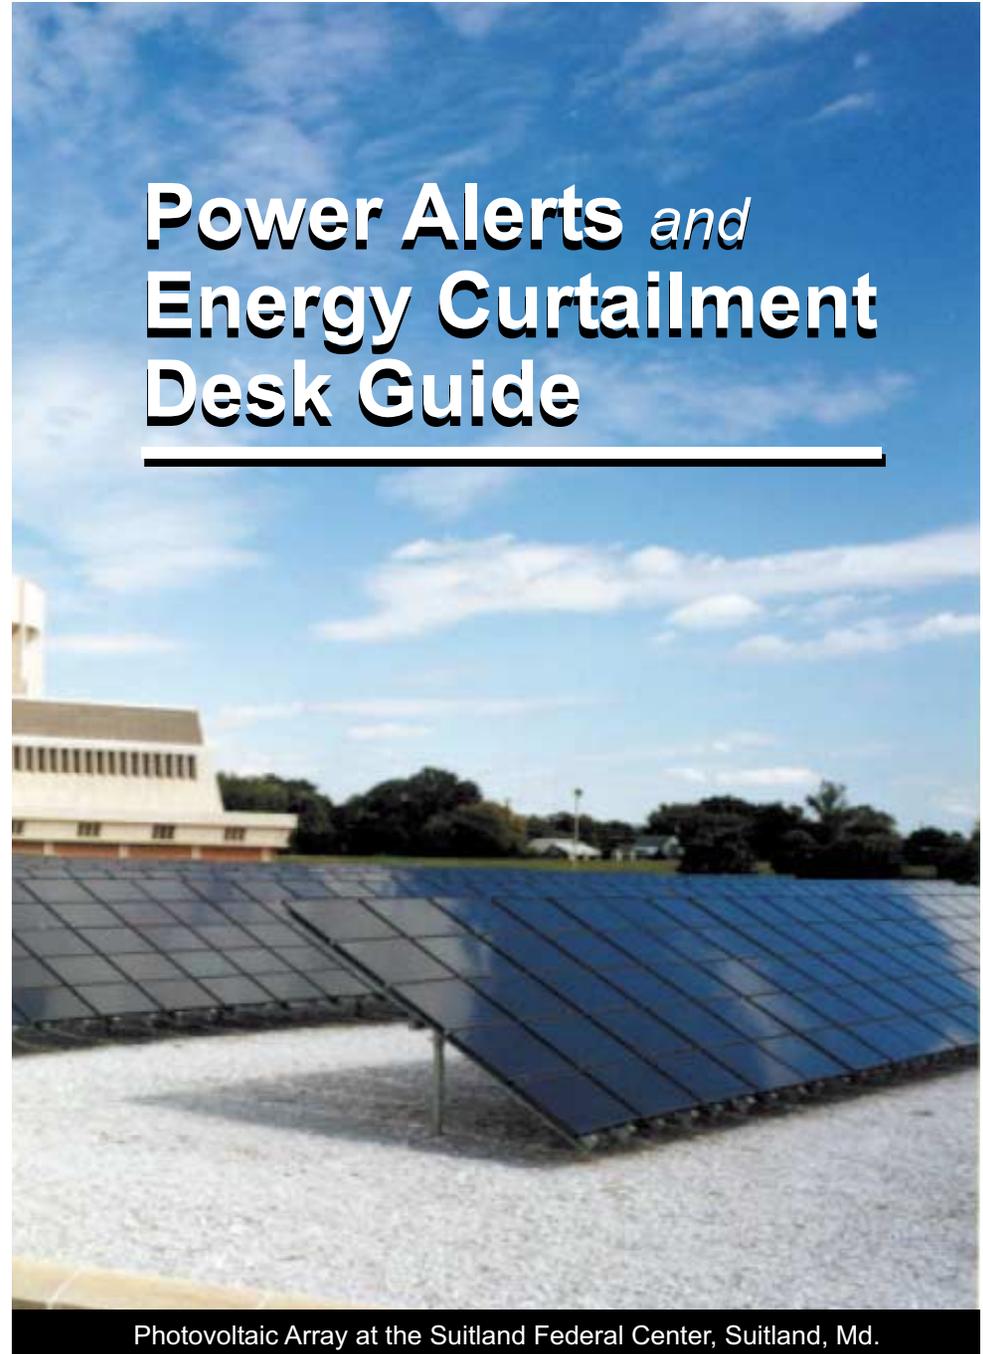

# Power Alerts *and* Energy Curtailment Desk Guide

---

Photovoltaic Array at the Suitland Federal Center, Suitland, Md.

## Introduction

This guide is intended to explain the National Capital Region's alerts and necessary actions when the regional power transmission system (the Pennsylvania – Jersey – Maryland or PJM Interconnection) is subjected to a condition that could affect system reliability and warrants the implementation of emergency measures. Such conditions could include equipment failure, extreme weather conditions, fuel shortages, or terrorist activities.

As representatives of the Federal Government and building owner/operators, we need to insure that we consider the implications of potential problems with power delivery, and mitigate the impact that we have on the transmission system and our tenants.

The information contained in this guide will assist you in understanding what each alert means, and how it could or will affect your building(s). It will also assist you in requesting assistance and understanding from your tenants.

The GSA's Energy Center of Expertise (ECO) prepared this guide. If you have any questions, comments, or require further explanation, please contact the ECO at:

GSA/NCR/PBS  
Energy Center of Expertise (WPE)  
301 - 7<sup>th</sup> Street, SW, Room 4004  
Washington, DC 20407-0001

Telephone: 202.205.3588

Facsimile: 202.205.5049

" I recognize the right and the duty of this generation to develop and use the natural resources of our land; but I do not recognize the right to waste them, or to rob, by wasteful use, the generations that come after us."

-- Theodore Roosevelt

The GSA's Energy Center of Expertise (ECO) prepared this guide. It can also be found on [www.gsa.gov/energy](http://www.gsa.gov/energy). If you have any questions, comments, or require further explanation, please contact the ECO at:

GSA/NCR/PBS  
Energy Center of Expertise (WPE)  
301 - 7<sup>th</sup> Street, SW, Room 4004  
Washington, DC 20407-0001

Telephone: 202.205.3588

Facsimile: 202.205.5049

# Table of Contents

## Introduction

## Background Information

WHAT IS THE PJM INTERCONNECTION, AND HOW DOES IT RELATE TO ME?	1
WHY SHOULD I CARE?	2
DOESN'T MY POWER COME FROM PEPCo (OR DOMVA. . .)?	3
HOW DOES THIS WORK WITH ELECTRICITY DEREGULATION?	
WAIT A MINUTE; WHAT IS ELECTRIC DEMAND, ANYWAY?	4

<b>How Will I Be Notified?</b>	<b>6</b>
--------------------------------	----------

<b>Alert Definitions (What does it mean when...?)</b>	<b>7</b>
---	----------

<b>References</b>	<b>9</b>
-------------------	----------

## References

- 1 PJM “The Power of Connecting”
- 2 GSA NCR PBS Transition Briefing Book 2002
- 3 PJM Emergency Operations Manual M-13

### Level 4 – “Demand Curtailment”

When a “Demand Curtailment” alert is sent, you should begin building system load reductions as outlined in the BOP. You should also notify tenant(s) and ask for cooperation with plug load and lighting reductions. Maximize use of daylight, task lights, and minimize general overhead lighting. Also allow temperatures to increase (2 or more degrees F) in the afternoons (coordinate this with tenants in advance – recommend agencies adopt an appropriate “casual dress” policy for extended periods).

### Level 5 – “Maximum Effort”

“Maximum Effort” means that YOU AND YOUR TENANT should be doing everything possible to reduce electric load, particularly in the afternoon.

## Background Information

### WHAT IS THE PJM INTERCONNECTION, AND HOW DOES IT RELATE TO ME?

The Pennsylvania – Jersey – Maryland (PJM) Interconnection is a company that operates the regional transmission system, or “power grid.” The system physically connects power lines from one utility to another, and is responsible for insuring the stability of power, power quality, and that adequate power supply is available for all customers.

PJM accomplishes this by coordinating generation efforts among all potential generators, with system requirements (i.e., customer demand). In effect, the large territory that PJM controls is beneficial, because it is easier to predict demand over a larger cross section of customers.

To get an idea of PJM’s scale, they are responsible for (1):

- 25.1 million people in the control area
- 614 generation sources of diverse fuel types (over 67,000 megawatts)
- 13,100 miles of transmission lines

The PJM operators forecast demand and communicate system-wide requirements to generators in the region. Once this is done, it just becomes a matter of making sure the electricity can be delivered to local utility companies such as PEPco, Dominion VA Power, Baltimore Gas & Electric, etc. The local utility company is ultimately responsible for getting the power to the consumer.

PJM communicates directly with the generators and the local utilities to meet the demands placed on the system. From time to time, a problem will arise in the system that requires action on the part of utilities. When this happens, a message is broadcast to entities that need to know. The GSA Energy Center of Expertise (ECOE) receives status routinely from the PJM through the Internet.

As information is received by the ECOE, we determine if the alert would potentially impact GSA, and if so, we broadcast the information internally via email to GSA PBS offices in NCR and Region 3 that could be affected. Ultimately it is up to you to implement necessary changes in your building operation to help stabilize the grid when the condition warrants.

## WHY SHOULD I CARE?

The GSA NCR Portfolio is composed of more than 84 million rentable square feet in more than 650 owned and leased buildings (2). Based on this, the GSA is responsible for a sizable portion of the load on the grid.

As the area develops further and more electric load is placed on the transmission system, it becomes closer to its maximum capacity. During the summer of 2002, we saw more record-setting peak days than had been predicted. This could indicate that the need for electricity is growing faster than the ability to produce it and move it to the customers.

Sometimes the “need” for electricity is artificially inflated because of an event in the system. A hot weather spell, for example, will cause an extreme demand on the system because of the energy intensive nature of air conditioning. During extended heat waves, the situation can get worse. For example, this summer the extreme heat and electric demand caused transmission equipment to fail, further stressing the system. Some areas were warned of potential rolling blackouts, similar to what was seen in California in recent years.

The Federal Government has a responsibility to act quickly and decisively to assist in making the electric energy infrastructure reliable. We are not alone in this. Commercial and industrial entities are also interested in insuring the stability of the power system. GSA participates with commercial and industrial customers in utility “roundtable” discussions periodically to discuss curtailment plans and what does and does not work. The notifications that the ECOE now receives from the PJM interconnection are a result of those roundtables.

## Alert Definitions *a.k.a. What does it mean when?*

### Level 1 – “Normal Operations”

“Normal Operations” is just that. Run the building as you normally would.

### Level 2 – “High Demand Possible”

“High Demand Possible” means that the regional power grid is expecting a higher than normal load. This should be a signal to you that a “Level 3” alert could be issued, and to begin preparations. When a “Level 2” alert has been issued, you should be reviewing the Building Operation Plan (BOP) to identify potential demand reductions.

### Level 3 – “High Demand Warning”

When you receive a “High Demand Warning” alert, you should begin low-impact curtailments (those that you and your tenant(s) have identified as having little or no effect on the tenants). Such curtailments might include reduced accent lighting; minimal reduction in elevator/escalator service; slightly increased (1 degree Fahrenheit) temperatures in the afternoons; etc.

At this point you should notify your tenant(s). Advise them of the alert you have received and keep them informed.

You should also prepare to curtail building system load, if a “Level 4” alert is issued.



