# WIRELESS THERMOSTATS FOR PNEUMATIC SYSTEMS


### **OPPORTUNITY**

Where are pneumatic thermostats typically found?

## COMMERCIAL BUILDINGS BUILT BEFORE 1999 that are > 20,000 ft2 and multi-story<sup>1</sup>

#### **TECHNOLOGY**

How do Wireless
Pneumatic
Thermostats work?

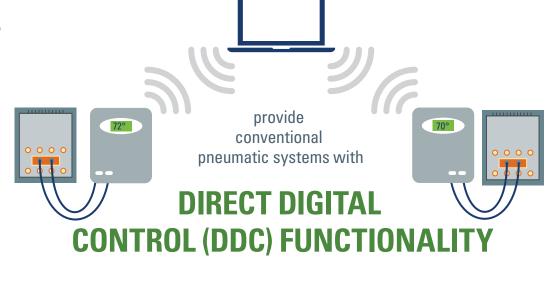

### M&V

Where did
Measurement and
Verification occur?

**OAK RIDGE NATIONAL LABORATORY** assessed wireless pneumatic thermostats provided by Cypress Envirosystems at the Woodrow Wilson International Center for Scholars in Washington, DC

#### **RESULTS**

How did Wireless Pneumatic Thermostats perform in M&V?

### **EFFECTIVE**

**APPLICATION** of Energy-saving

control strategies<sup>2</sup>

## **ENERGY** SAVINGS

across climate zones and office sizes<sup>3</sup>

## <2-6 YRS PAYBACK

with unoccupied/ occupied control strategy and low installation costs<sup>4</sup>

### **Modeled Payback for Unoccupied/Occupied Control Strategy**

Payback assumes an unoccupied setback of 83° for cooling and 62° for heating

Location		<b>Large Office - 498,500 ft²</b> Payback (years)		<b>Medium Office - 53,630 ft²</b> Payback (years)		<b>Small Office - 5,500 ft²</b> Payback (years)	
CLIMATE ZONE	CITY	L0W <sup>1</sup>	HIGH <sup>2</sup>	L0W <sup>3</sup>	HIGH⁴	L0W <sup>5</sup>	HIGH <sup>6</sup>
1A	Miami, FL	3.6	6.5	3.7	6.8	1.9	3.3
2A	Houston, TX	3.7	6.7	4.5	8.2	2.9	5.0
2B	Phoenix, AZ	4.6	8.2	4.0	7.3	2.5	4.3
3A	Atlanta, GA	3.0	5.4	3.5	6.4	2.6	4.5
3B-coast	Los Angeles, CA	2.8	5.1	3.7	6.8	3.7	6.3
3B	Las Vegas, NV	5.3	9.5	5.0	9.2	3.1	5.4
3C	San Francisco, CA	3.0	5.5	3.8	7.0	3.2	5.5
4A	Baltimore, MD	2.8	5.0	3.3	6.0	2.7	4.7
4B	Albuquerque, NM	5.4	9.7	6.0	10.9	3.5	5.9
4C	Seattle, WA	3.6	6.5	4.5	8.2	4.3	7.4
5A	Chicago, IL	3.1	5.6	3.8	7.0	2.8	4.8
5B	Boulder, CO	5.0	8.9	5.7	10.5	3.7	6.4
6A	Minneapolis, MN	4.6	8.3	5.7	10.5	3.7	6.3
6B	Helena, MT	3.9	7.1	4.6	8.4	3.3	5.7
7	Duluth, MN	4.3	7.8	5.3	9.7	3.7	6.3
8	Fairbanks, AK	4.2	7.6	5.2	9.5	3.1	5.3

 $Installation \ Costs: \qquad {}^{1}\$0.50/ft^{2} \quad {}^{2}\$0.90/ft^{2} \quad {}^{3}\$0.60/ft^{2} \quad {}^{4}\$1.10/ft^{2} \quad {}^{5}\$0.70/ft^{2} \quad {}^{6}\$1.20/ft^{2} \quad {}^{$ 

### **DEPLOYMENT**

Where does M&V recommend deploying Wireless Pneumatic Thermostats?

### **ANY FACILITY**

### WITH CONVENTIONAL PNEUMATIC CONTROLS\*

Deployment priority should be given to facilities with high energy costs

<sup>1</sup>Wireless Pneumatic Thermostat Evaluation, Ronald Reagan Building and International Trade Center, Washington, DC, Dan Howett, P.E., Mahabir Bhandari, PhD ORNL, March 2015, p. 2 2lbid, p.3 <sup>3</sup>lbid, p.4 <sup>4</sup>Subject to evaluation and approval by GSA-IT and Security

